


Gigabix Typical FDF Layout

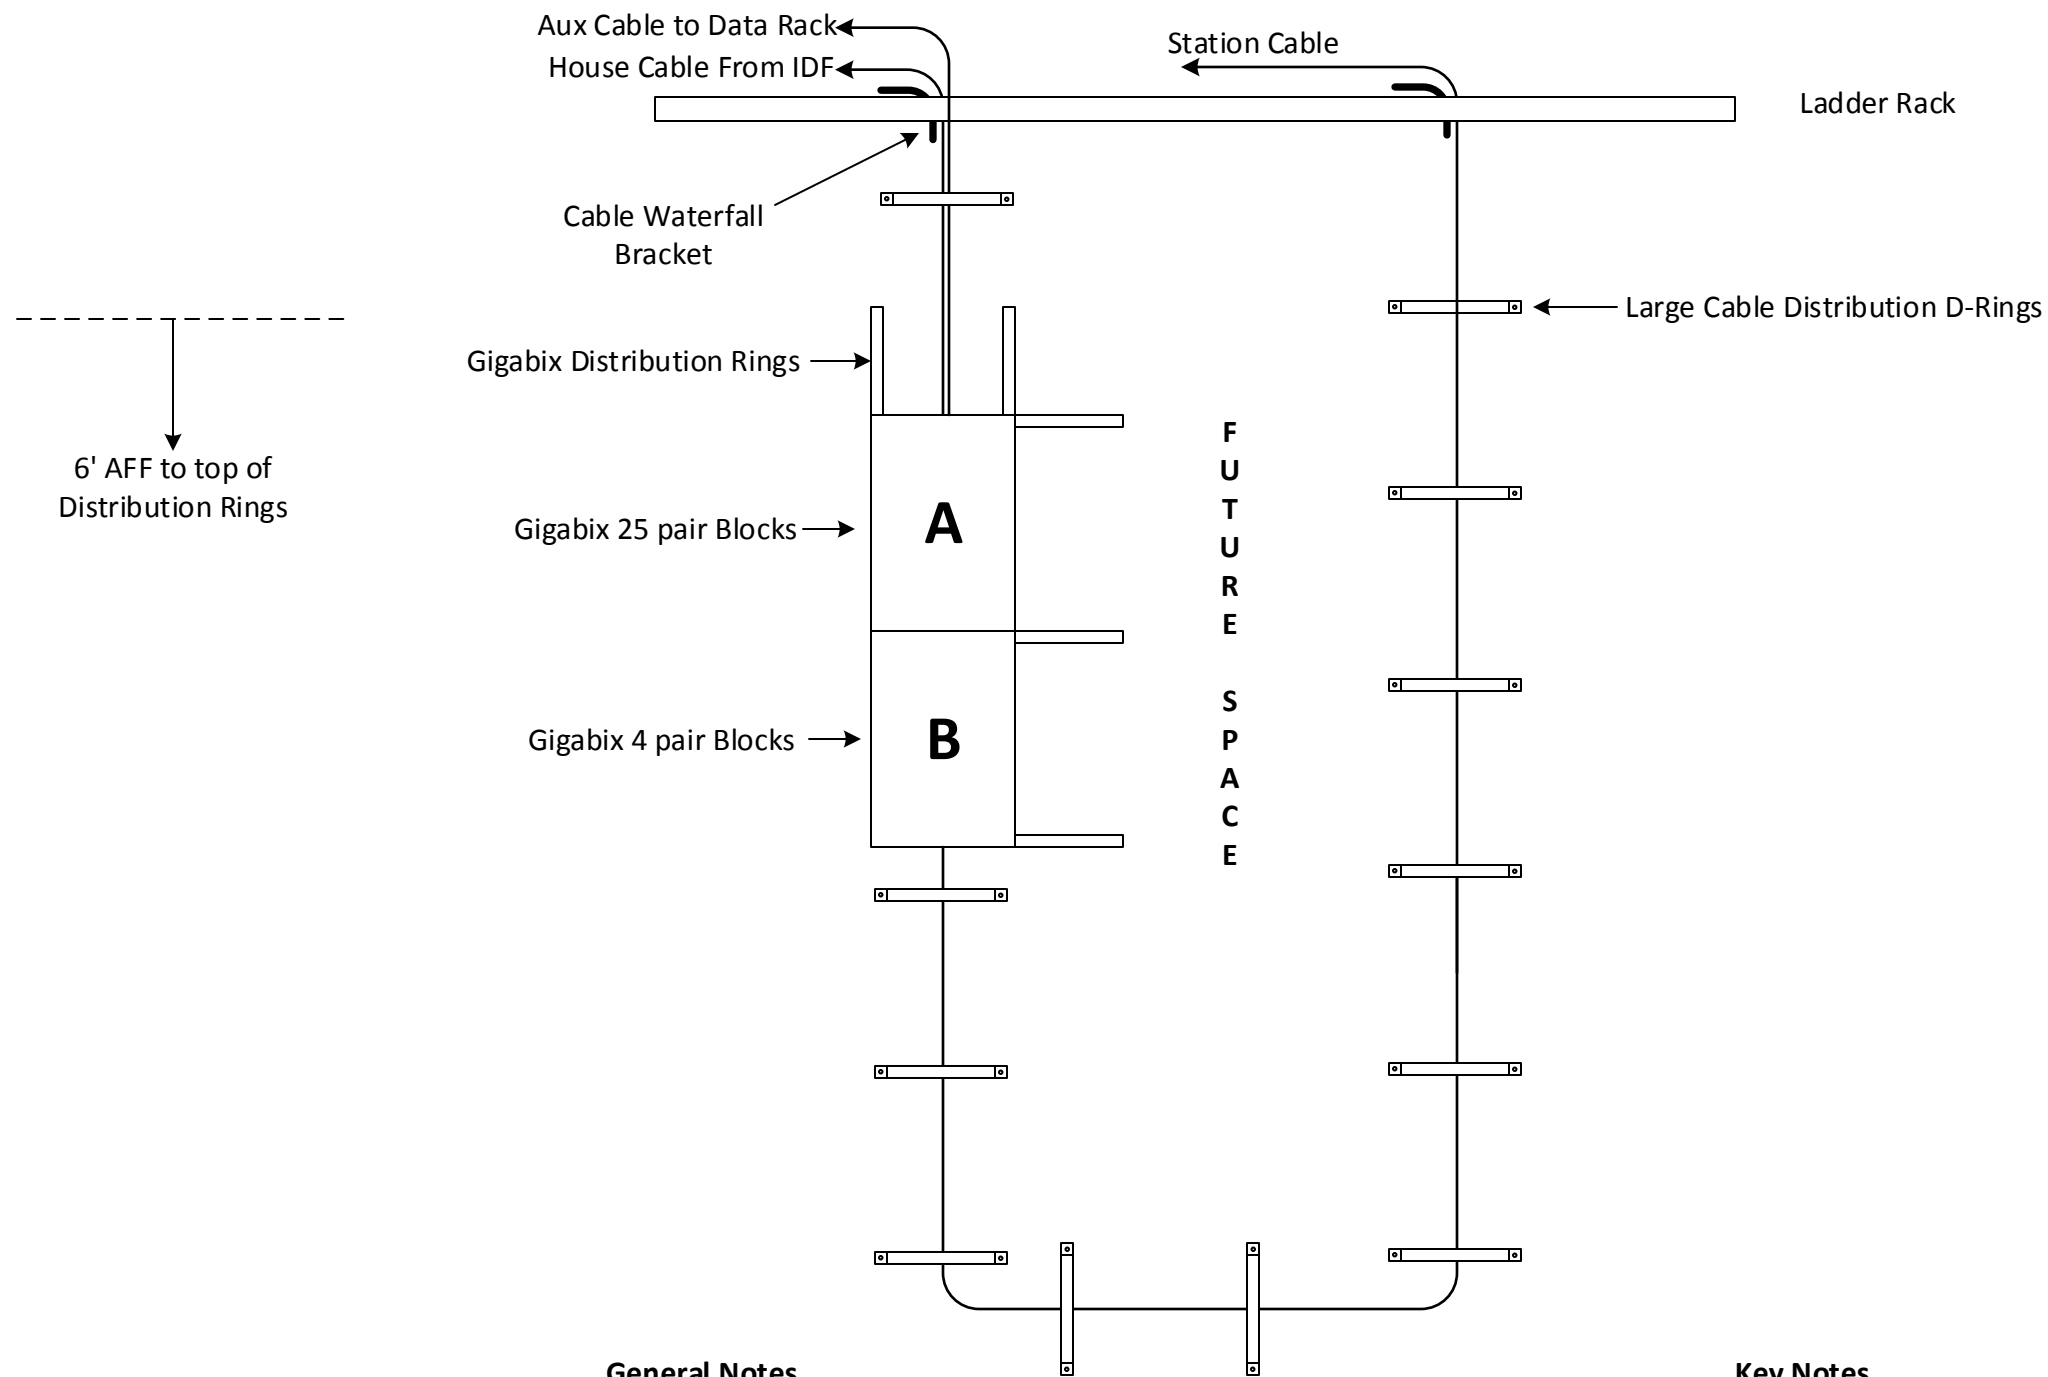

General Notes

1. All Hardware Belden GigaBix
2. Consult ACCC Standards for Part Numbers
3. All Labeling and terminations to be coordinate with UIC ACCC Engineering

Key Notes

- A – 300 pr frame - House Cable Pairs 1-100 Aux Cable 1-50
- B – 300 pr frame - ETU Station Cabling